


SECTION 1
PROFILE VIEW

PLAN VIEW

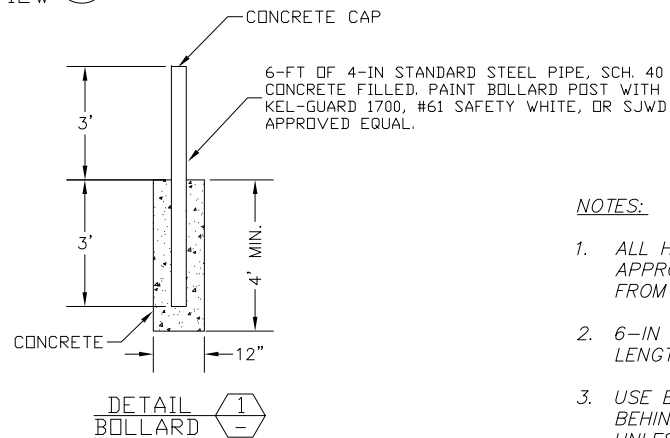

NOTES:

1. ALL HYDRANT LATERALS SHALL BE DIP UNLESS OTHERWISE APPROVED BY SJWD, AND SHALL BE MECHANICALLY RESTRAINED FROM VALVE TO BURY.
2. 6-IN DIAMETER DIP ALLOWED FOR LATERALS UP TO 18-FT IN LENGTH. IF OVER 18 LF USE 8-IN DIAMETER DIP.
3. USE BOLLARD ONLY WHERE HYDRANT IS LESS THAN 5-FT BEHIND CURB OR LESS THAN 8-FT BEHIND PAVEMENT EDGE UNLESS OTHERWISE DIRECTED BY SJWD.

NO	DATE	REVISIONS	APP	BY



FILL -SLOPE FIRE HYDRANT

SAN JUAN WATER DISTRICT

APPROVED

SCALE: NTS PRINT DATE: 07/13/07 DETAIL NO. SHT 3 OF 27